




Response time data for Fire Rescue Victoria (FRV) appliances responding to Structure Fires in the FRV Fire District where the FRV appliances are primary appliances (1st appliance onscene)



Reporting Period: 1 April 2024 - 30 June 2024

Emergency Structure Fires meeting benchmark by Station Maintenance Area

Primarily residential structure fires including commercial centres, industrial and/or community services e.g. schools, facilities, hospitals. FRV has service delivery standards, which specify a response time target for a station to attend an emergency incident. The service delivery standard (response time) for Structure Fire is 7.7 minutes.



FRV District + Station Maintenance Area	Number of incidents within the Station Maintenance Area for the reporting period	Number of emergency incidents within the Station Maintenance Area for the reporting period	Number of emergency incidents the standards were met by any station	% of emergency incidents the standards were met by any station	The time in minutes in which 90% of emergency incidents were responded to by any station
Central District	309	304	291	95.7%	6.8
1 - Eastern Hill	34	32	32	100.0%	5.3
2 - West Melbourne	31	30	29	96.7%	6.6
3 - Carlton	42	42	41	97.6%	6.0
4 - Brunswick	18	18	18	100.0%	6.6
10 - Richmond	38	38	37	97.4%	6.4
13 - Northcote	20	20	19	95.0%	6.5
18 - Hawthorn	18	16	14	87.5%	7.8
35 - Windsor	53	53	49	92.5%	7.0
38 - South Melbourne	30	30	29	96.7%	6.2
50 - Ascot Vale	25	25	23	92.0%	7.5
Eastern District	53	50	49	98.0%	6.5
20 - Box Hill	13	12	12	100.0%	5.9
22 - Ringwood	12	12	12	100.0%	6.4
26 - Croydon	14	13	12	92.3%	7.2
28 - Vermont South	14	13	13	100.0%	6.5
North West Region	24	24	24	100.0%	6.4
72 - Mildura	13	13	13	100.0%	6.1
73 - Bendigo	11	11	11	100.0%	6.6
Northern District	92	92	82	89.1%	7.8
5 - Broadmeadows	26	26	23	88.5%	7.7
6 - Pascoe Vale	14	14	14	100.0%	7.0
7 - Thomastown	14	14	13	92.9%	7.5
9 - Somerton	11	11	9	81.8%	8.4
12 - Preston	17	17	16	94.1%	7.5
80 - Craigieburn	10	10	7	70.0%	8.6
South East Region	13	13	13	100.0%	6.9
75 - Shepparton	13	13	13	100.0%	6.9
Southern District 1	92	90	80	88.9%	7.7
24 - Glen Iris	17	16	16	100.0%	6.6
25 - Oakleigh	13	13	11	84.6%	7.6
31 - Glen Waverley	13	13	12	92.3%	7.0
32 - Ormond	21	20	18	90.0%	6.6
34 - Highett	12	12	10	83.3%	8.3
89 - Springvale	16	16	13	81.3%	7.9
Southern District 2	100	100	91	91.0%	7.6
87 - Dandenong	28	28	25	89.3%	7.6
88 - Hallam	25	25	24	96.0%	7.4
90 - Patterson River	11	11	11	100.0%	6.9
91 - Frankston	21	21	19	90.5%	7.4
92 - Cranbourne	15	15	12	80.0%	8.9
Western District 1	59	55	42	76.4%	10.4
47 - Footscray	21	21	18	85.7%	7.9
57 - Tarneit	24	22	13	59.1%	11.8
58 - Point Cook	14	12	11	91.7%	7.2
Western District 2	70	70	57	81.4%	8.5
41 - St. Albans	16	16	16	100.0%	7.3
44 - Sunshine	19	19	18	94.7%	6.8
52 - Tullamarine	11	11	9	81.8%	8.1
55 - Caroline Springs	13	13	5	38.5%	9.6
56 - Melton	11	11	9	81.8%	7.8
Western District 3	16	16	14	87.5%	8.0
62 - Corio	16	16	14	87.5%	8.0
Total	828	814	743	91.3%	7.5




Response time data for Fire Rescue Victoria (FRV) appliances responding to Structure Fires in the FRV Fire District where the FRV appliances are primary appliances (1st appliance onscene)




Emergency Structure Fires - Response Times Meeting Benchmarks

Reporting Period: 1 April 2024 - 30 June 2024

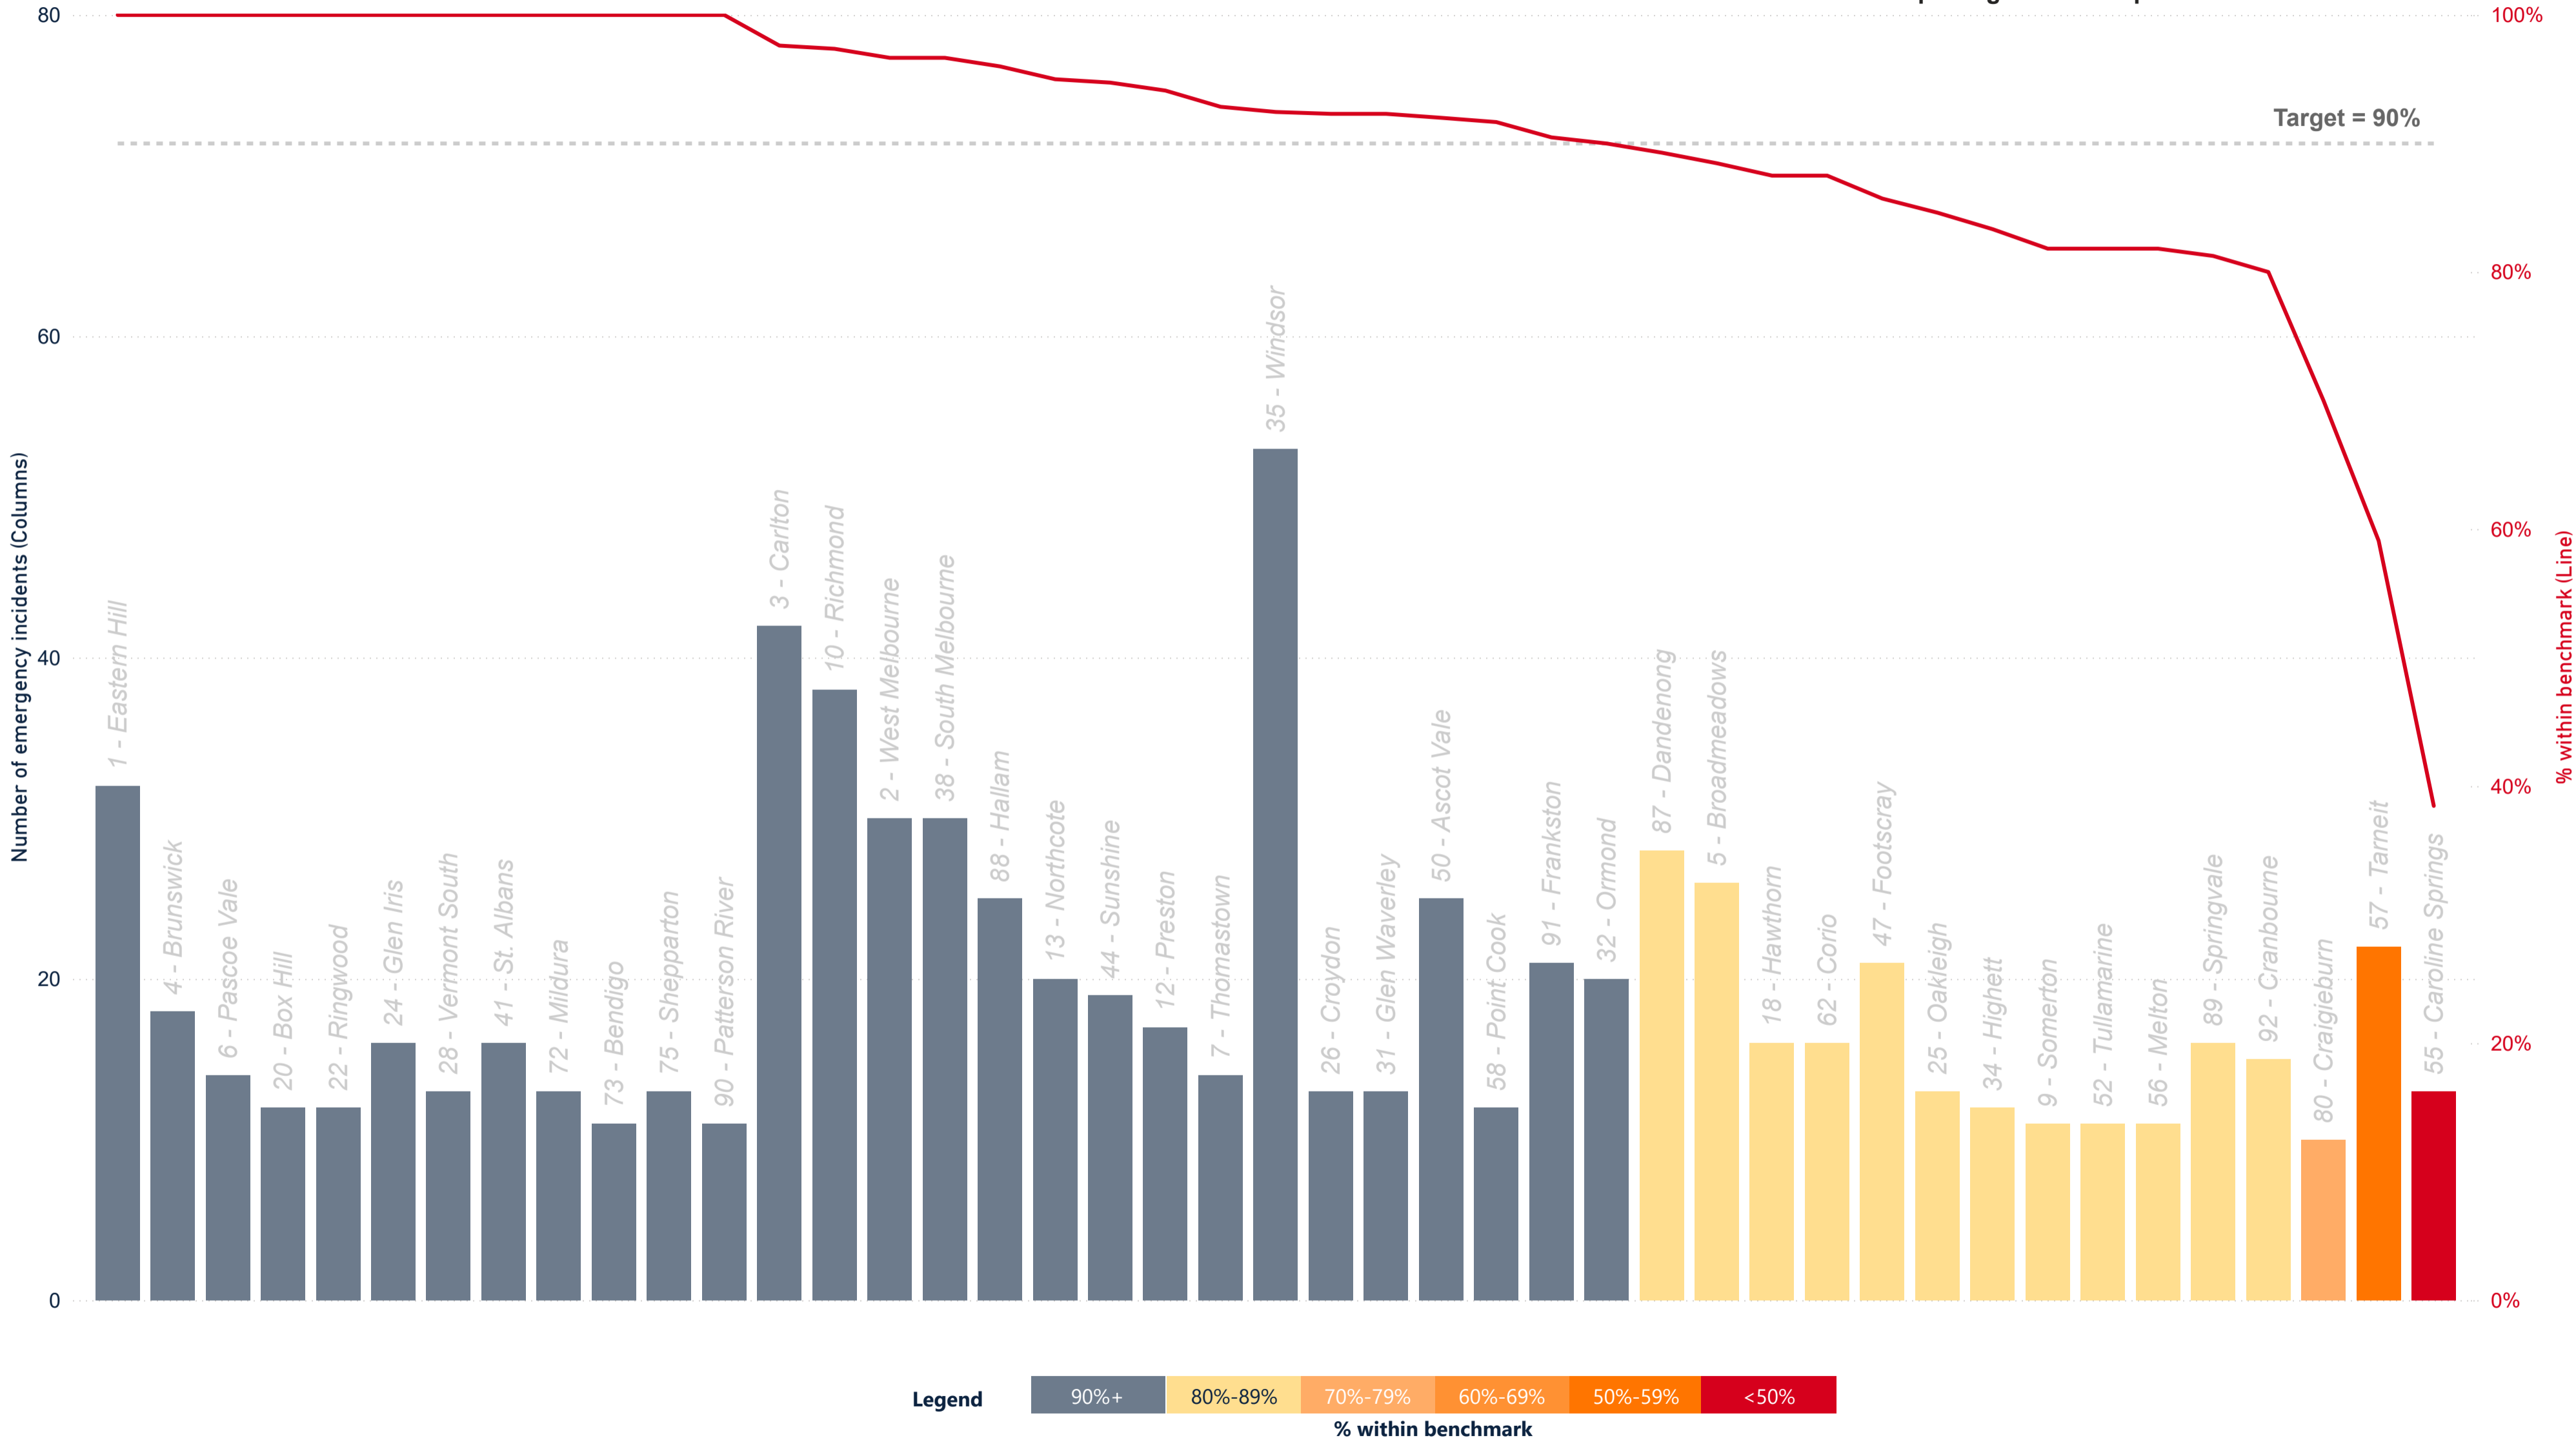

Response time data for Fire Rescue Victoria (FRV) appliances responding to Structure Fires in the FRV Fire District where the FRV appliances are primary appliances (1st appliance onscene), from 1 April 2024 to 30 June 2024.

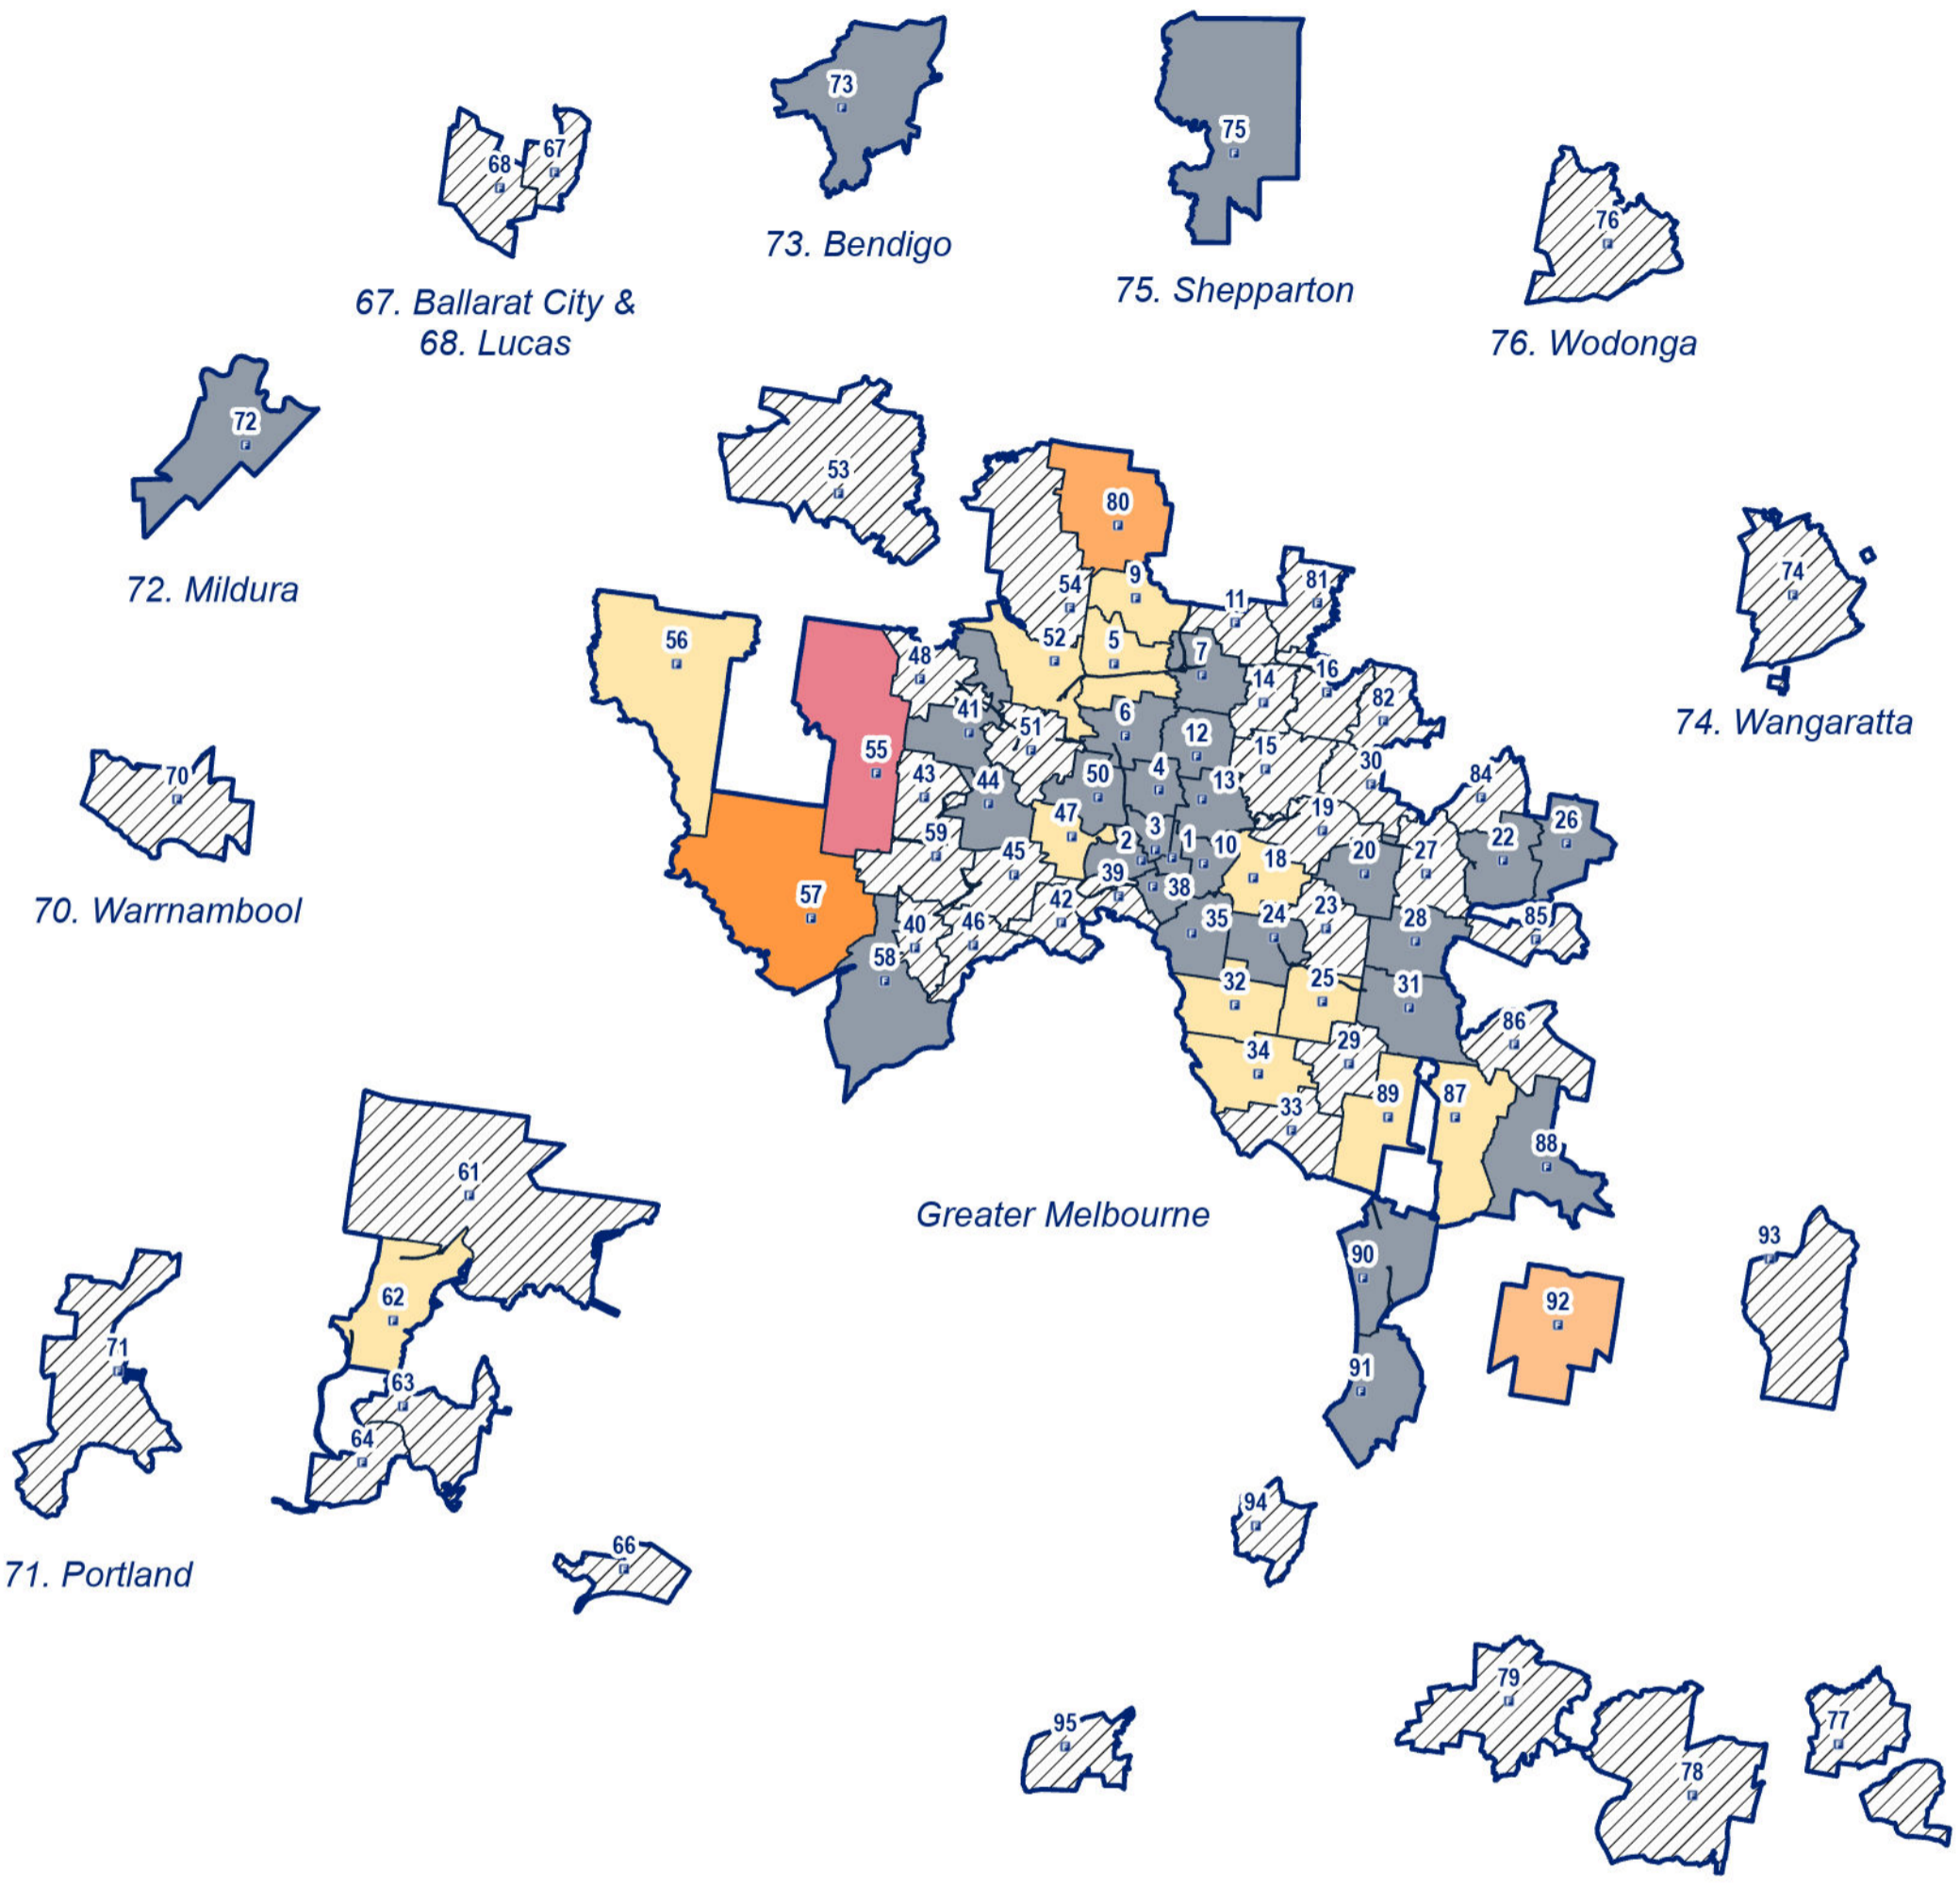

- FRV Fire Station
 - FRV Boundary
 - Maintenance Area
 - SMA with < 10 emergency incidents
- Within Target Percentage
- <50%
 - 50 - 60%
 - 60 - 70%
 - 70 - 80%
 - 80 - 90%
 - 90 - 100%

FRV Business Intelligence & GIS
 Map produced: March 2024
 Request ID: Public Reporting/FY24/Q2/Maps

(c) State Government of Victoria 2024
 This map is a snapshot generated from Victorian Government data as well as data from various other sources. This does not guarantee that the publication is without flaw of any kind or is wholly appropriate for your particular purposes and therefore disclaims all liability for error, loss or damage which may arise from reliance upon it. All persons accessing this information should make appropriate enquiries to assess the currency of the data.

