



Reporting Period: 1 July 2024 - 30 September 2024

Emergency Structure Fires meeting benchmark by Station Maintenance Area

Primarily residential structure fires including commercial centres, industrial and/or community services e.g. schools, facilities, hospitals. FRV has service delivery standards, which specify a response time target for a station to attend an emergency incident. The service delivery standard (response time) for Structure Fire is 7.7 minutes.



FRV District + Station Maintenance Area	Number of incidents within the Station Maintenance Area for the reporting period	Number of emergency incidents within the Station Maintenance Area for the reporting period	Number of emergency incidents the standards were met by any station	% of emergency incidents the standards were met by any station	The time in minutes in which 90% of emergency incidents were responded to by any station
Central District	295	285	265	93.0%	6.9
1 - Eastern Hill	34	32	30	93.8%	6.5
2 - West Melbourne	20	18	18	100.0%	6.5
3 - Carlton	43	43	42	97.7%	6.1
4 - Brunswick	25	23	23	100.0%	6.5
10 - Richmond	39	38	38	100.0%	5.7
13 - Northcote	16	16	11	68.8%	8.4
18 - Hawthorn	17	17	16	94.1%	7.0
35 - Windsor	43	42	38	90.5%	7.6
38 - South Melbourne	32	30	29	96.7%	7.0
50 - Ascot Vale	26	26	20	76.9%	8.5
Eastern District	29	29	28	96.6%	7.0
22 - Ringwood	14	14	13	92.9%	7.1
27 - Nunawading	15	15	15	100.0%	6.8
North West Region	37	37	32	86.5%	9.0
72 - Mildura	20	20	15	75.0%	11.6
73 - Bendigo	17	17	17	100.0%	6.2
Northern District	100	98	88	89.8%	7.7
5 - Broadmeadows	21	21	17	81.0%	8.0
6 - Pascoe Vale	12	11	11	100.0%	6.1
7 - Thomastown	16	16	16	100.0%	7.2
11 - Epping	13	13	11	84.6%	7.9
12 - Preston	14	13	13	100.0%	7.3
14 - Bundoora	10	10	9	90.0%	7.5
16 - Greensborough	14	14	11	78.6%	8.2
South East Region	39	39	34	87.2%	8.2
75 - Shepparton	18	18	16	88.9%	7.6
77 - Traralgon	10	10	8	80.0%	9.8
78 - Morwell	11	11	10	90.9%	7.4
Southern District 1	80	79	76	96.2%	7.3
25 - Oakleigh	10	10	10	100.0%	6.9
32 - Ormond	24	24	23	95.8%	7.5
33 - Mentone	12	11	11	100.0%	7.1
34 - Highett	21	21	20	95.2%	7.3
89 - Springvale	13	13	12	92.3%	7.4
Southern District 2	88	87	72	82.8%	8.7
87 - Dandenong	27	26	24	92.3%	7.3
88 - Hallam	13	13	11	84.6%	9.9
91 - Frankston	27	27	24	88.9%	7.2
92 - Cranbourne	21	21	13	61.9%	10.4
Western District 1	61	61	50	82.0%	8.5
47 - Footscray	19	19	19	100.0%	7.0
57 - Tarneit	27	27	19	70.4%	8.9
58 - Point Cook	15	15	12	80.0%	9.2
Western District 2	80	79	59	74.7%	9.5
41 - St. Albans	15	15	14	93.3%	7.0
44 - Sunshine	20	19	18	94.7%	7.2
55 - Caroline Springs	16	16	10	62.5%	9.5
56 - Melton	29	29	17	58.6%	10.3
Western District 3	30	29	26	89.7%	7.6
62 - Corio	17	16	15	93.8%	7.0
63 - Geelong City	13	13	11	84.6%	7.8
Total	839	823	730	88.7%	8.0




Response time data for Fire Rescue Victoria (FRV) appliances responding to Structure Fires in the FRV Fire District where the FRV appliances are primary appliances (1st appliance onscene)



Emergency Structure Fires - Response Times Meeting Benchmarks


Reporting Period: 1 July 2024 - 30 September 2024

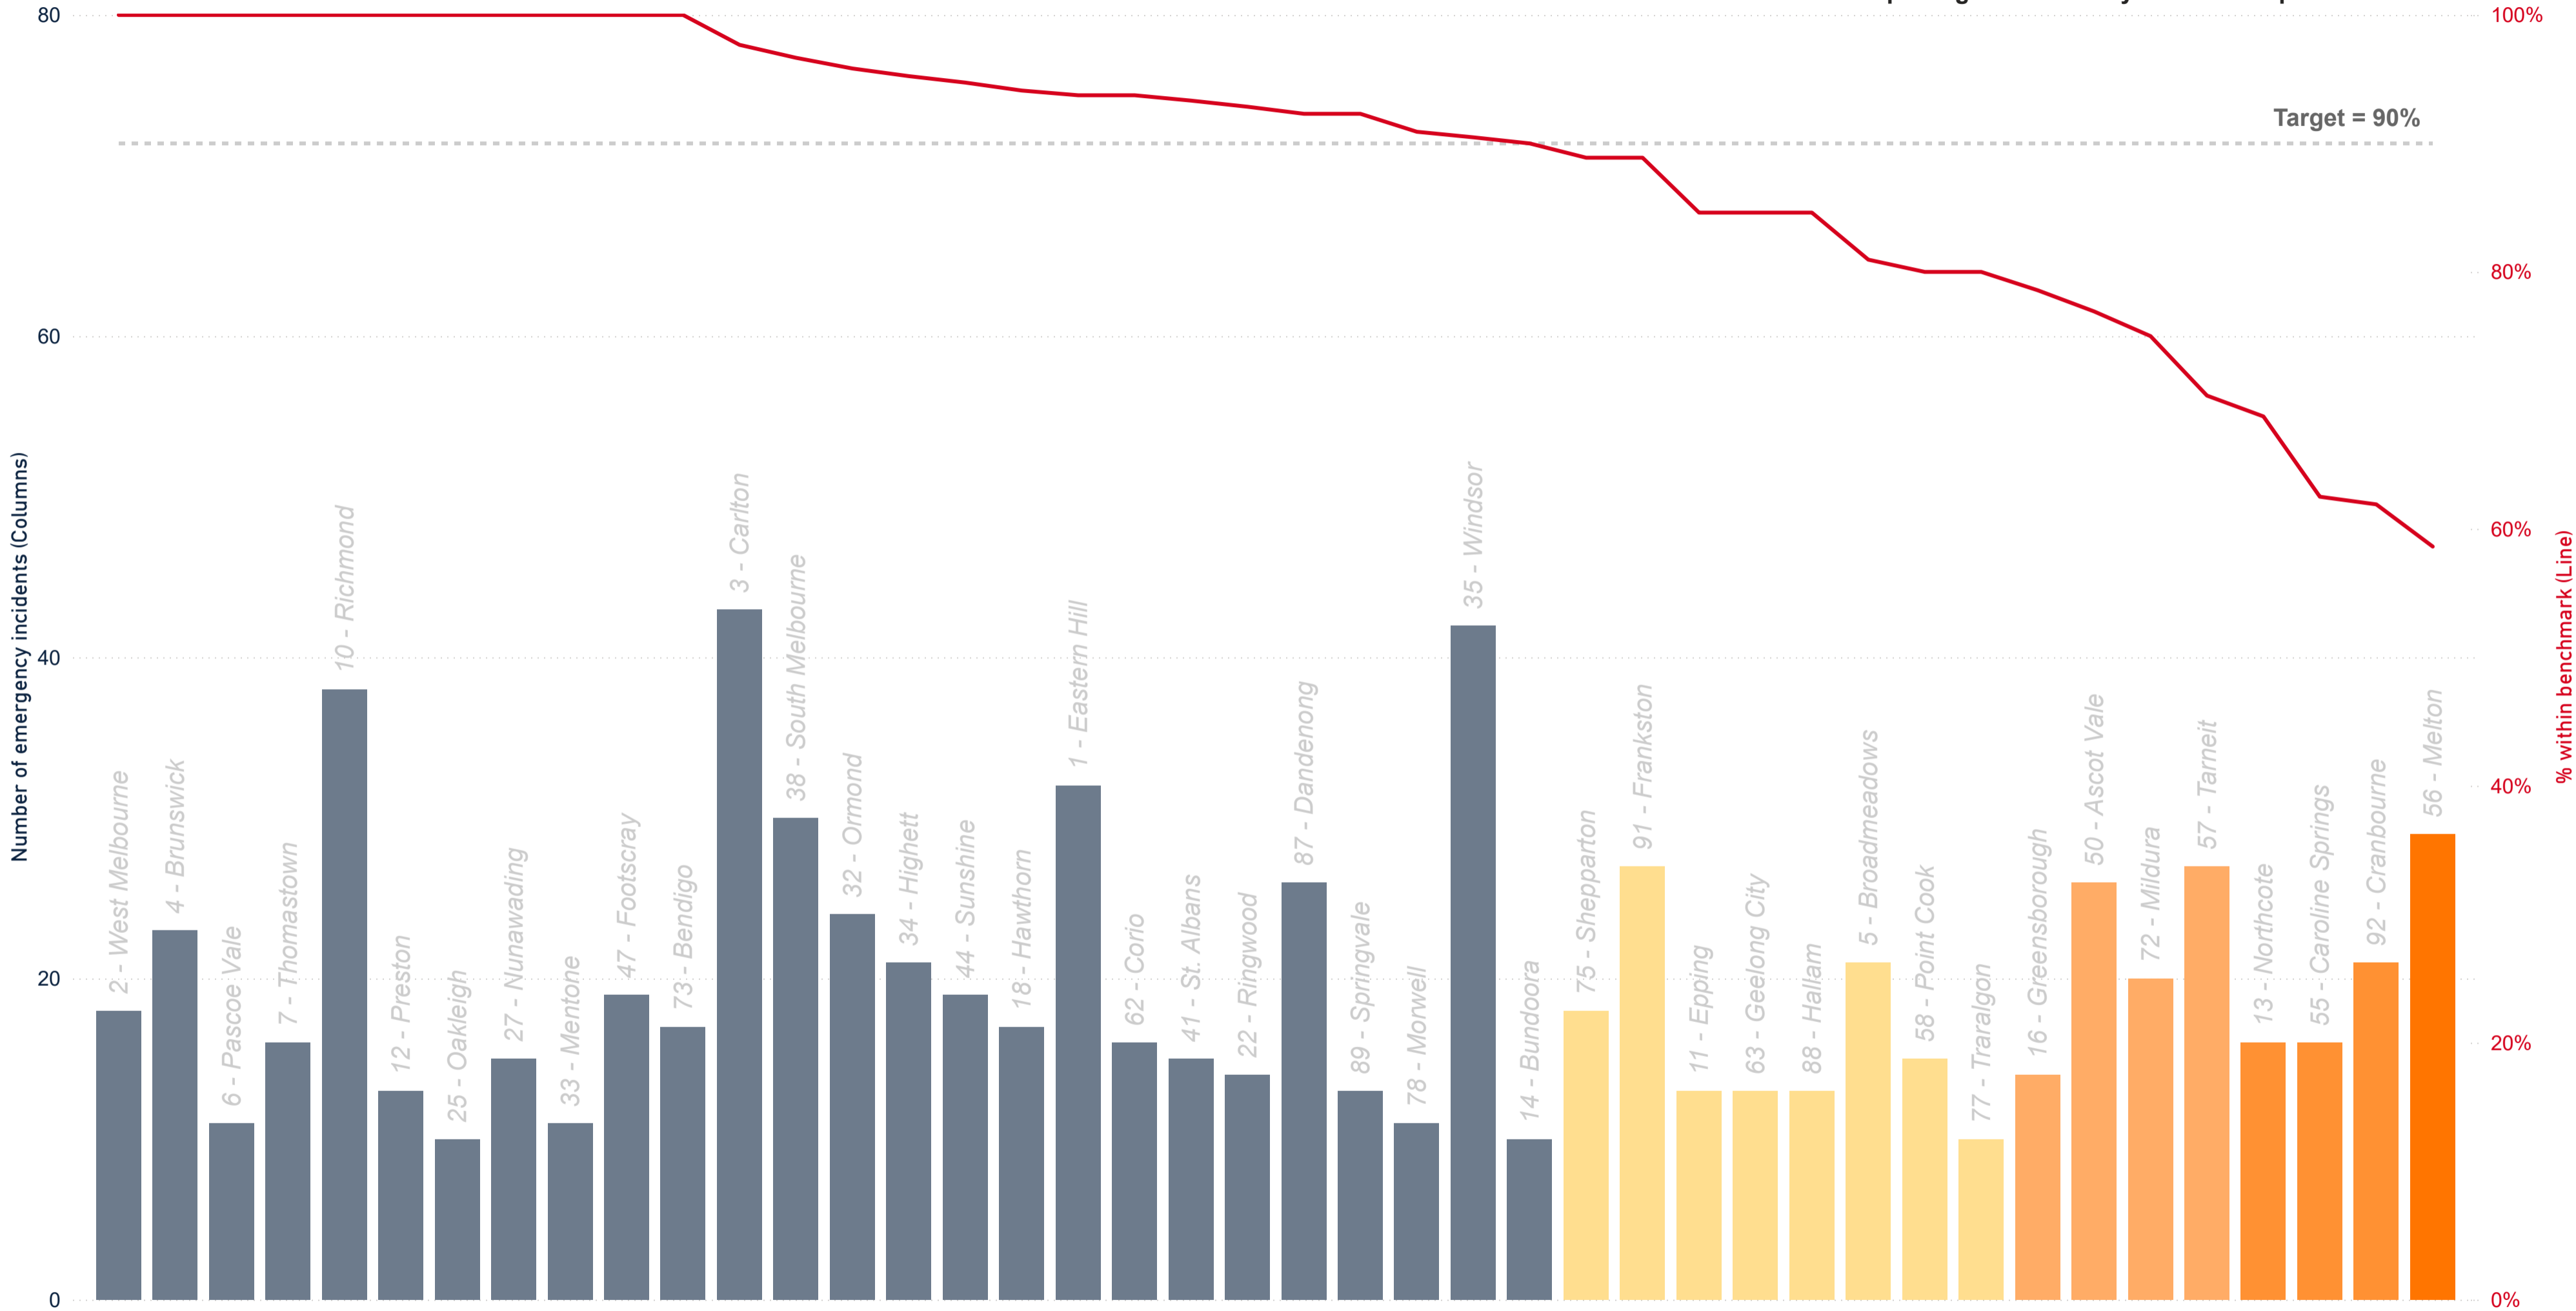

Legend



% within benchmark

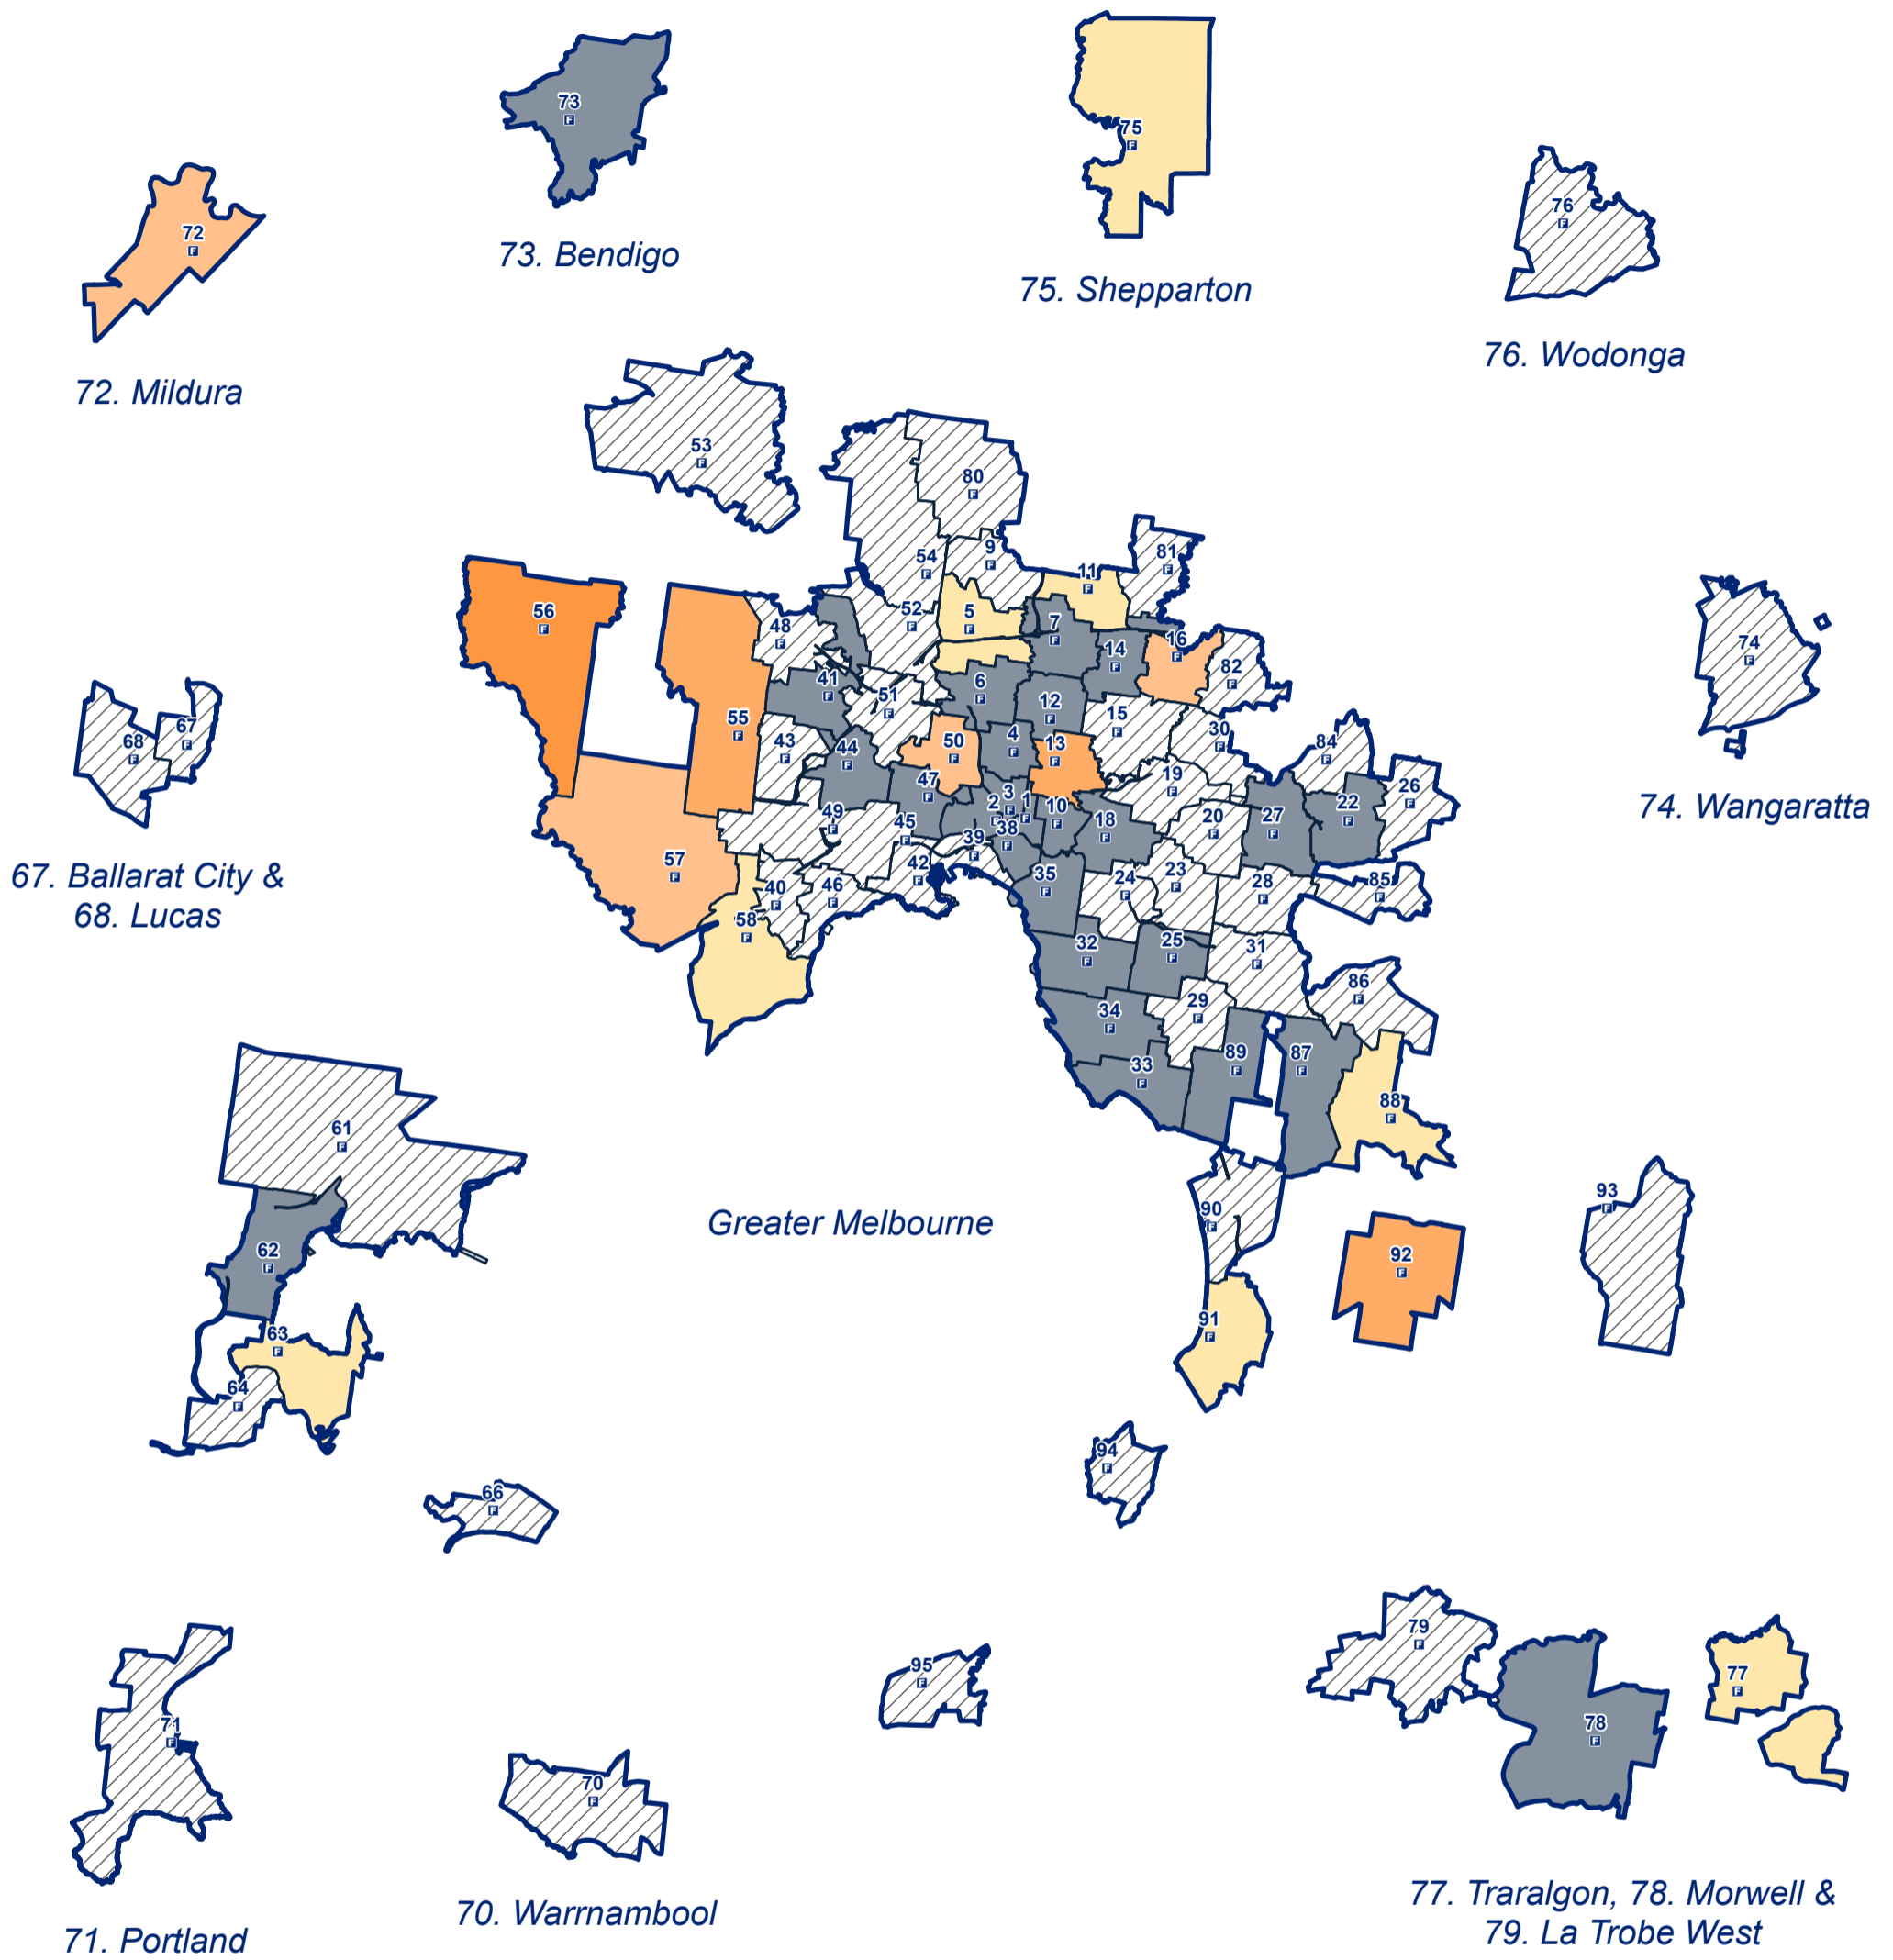

- FRV Fire Station
- FRV Boundary
- Maintenance Area (MA)
- MA with < 10 SF incidents
- Within Target Percentage
 - Below 50%
 - 50 - 60%
 - 60 - 70%
 - 70 - 80%
 - 80 - 90%
 - 90 - 100%

FRV Business Intelligence & GIS
 Map produced: December 2024
 Request ID: Public Reporting/FY25/Q1/Maps

(c) State Government of Victoria 2024
 This map is a snapshot generated from Victorian Government data as well as data from various other sources. This does not guarantee that the publication is without flaw of any kind or is wholly appropriate for your particular purposes and therefore disclaims all liability for error, loss or damage which may arise from reliance upon it. All persons accessing this information should make appropriate enquiries to assess the currency of the data.

